



KNX T-B-UP

Temperature Sensor

Technical specifications and installation instructions



1. Description

The **KNX T-B-UP** measures ambient temperature. The sensor can receive an external measured value via the bus and process it with the own data to an overall temperature (mixed value). The **KNX T-B-UP** offers two push buttons for changing the ambient temperature (target value).

The **KNX T-B-UP** provides four switching outputs with adjustable threshold values as well as additional AND and OR logic gates. The sensor has got a PI controller for heating and cooling.

The integrated display shows the own value and data received from the bus (e. g. date, time). The housing is completed with a frame of the switching series installed in the building and thus merges with the interior.

Functions:

- Measurement of **temperature**
- **Display** 1-3 rows (own values or values received from the bus)
- **2 push buttons** for changing the ambient temperature at the device.
The step size can be adjusted from 0,1°C to 5°C.
- **Mixed value** from own measured value and external value (proportions can be set in percentage)
- **PI controller** for heating (one or two step) and cooling (one or two step)
- **4 switching outputs** with adjustable threshold values (Threshold values can be set by parameter or via communication objects)
- **4 AND and 4 OR logic gates** with each 4 inputs. Every switching incident as well as 8 logic inputs (in the form of communication objects) may be used as inputs for the logic gates. The output of each gate may optionally be configured as 1 bit or 2 x 8 bits

Configuration is made using the KNX software ETS. The **programme file** (format VD2), the data sheet and the manual can be downloaded from the Elsner Elektronik homepage on **www.elsner-elektronik.de** in the "Service" menu.

1.1. Scope of delivery

- Housing with display and sensor board
- Base plate

You will need *in addition* (not supplied):

- Socket Ø 60 mm, 42 mm deep
- Frame (for element 55 x 55 mm), suitable for the switching programme used in the building

1.2. Technical specifications

Housing	Plastic material (partly lacquered)
Colours	<ul style="list-style-type: none"> • White glossy (similar to RAL 9016 Traffic White) • Aluminium matt • Anthracite matt • Stainless steel • Special colours on request
Mounting	In-wall (in socket Ø 60 mm, 42 mm deep)
Protection category	IP 20
Dimensions	Housing approx. 55 x 55 (W x H, mm), mounting depth approx. 15 mm, base plate approx. 71 x 71 (W x H, mm)
Total weight	approx. 50 g
Ambient temperature	Operation -10...+50°C, Storage -20...+60°C
Ambient air humidity	max. 95% R. H., avoid bedewing
Operating voltage	KNX bus voltage
Bus current	max. 6 mA, max. 10 mA when programming LED is active
Data output	KNX +/- bus terminal plug
BCU type	Own micro controller
PEI type	0
Group addresses	max. 184
Allocations	max. 184
Communication objects	87
Measurement range	-40...+80°C
Resolution	0.1°C
Accuracy	±1°C at -10...+85°C ±1.5°C at -25...+150°C

The following standards have been considered for the evaluation of the product in terms of electro magnetic compatibility:

Transient emissions:

- EN 60730-1:2000 Section EMV (23, 26, H23, H26) (threshold category: B)
- EN 50090-2-2:1996-11 + A1:2002-01 (threshold category: B)
- EN 61000-6-3:2001 (threshold category: B)

Interference resistance:

- EN 60730-1:2000 Section EMV (23, 26, H23, H26)
- EN 50090-2-2:1996-11 + A1:2002-01
- EN 61000-6-1:2004

The product has been tested for the above mentioned standards by an accredited EMV laboratory.

2. Installation and commissioning

2.1. Notes on installation



Installation, inspection, commissioning and troubleshooting of the device must only be carried out by a competent electrician.

Disconnect all lines to be assembled, and take safety precautions against accidental switch-on.

The device is exclusively intended for appropriate use. With each inappropriate change or non-observance of the instructions for use, any warranty or guarantee claim will be void.

After unpacking the device, check immediately for any mechanical damages. In case of transport damage, this must immediately notified to the supplier.



If damaged, the device must not be put into operation.

If an operation without risk may supposedly not be guaranteed, the device must be put out of operation and be secured against accidental operation.

The device must only be operated as stationary system, i.e. only in a fitted state and after completion of all installation and start-up works, and only in the environment intended for this purpose.

Elsner Elektronik does not assume any liability for changes in standards after publication of this instruction manual.

2.2. Installation position

The sensor will be installed concealed within a socket (Ø 60 mm, 42 mm deep) and fitted with a frame from the switching programme used in the building. When selecting an installation location, please ensure that the measurement results are affected as little as possible by external influences. Possible sources of interference include:

- Direct sunlight
- Drafts from windows and doors
- When mounted in-wall: Draft from ducts which lead from other rooms to the junction box in which the sensor is mounted
- Warming or cooling of the building structure on which the sensor is mounted, e.g. due to sunlight, heating or cold water pipes
- Connection lines which lead from warmer or colder areas to the sensor

Temperature variations from such sources of interference must be corrected in the ETS in order to ensure the specified accuracy of the sensor (temperature offset).



The sensor may be installed and operated in dry interior rooms only. Avoid condensation.

2.3. Composition of the sensor

2.3.1. Casing

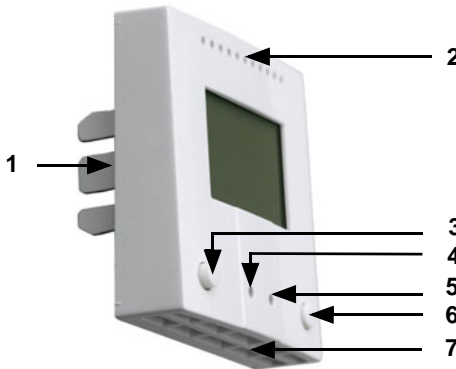


Fig. 1

- 1 Notches
- 2 Air circulation holes
- 3 Push button for lowering the ambient temperature (target value)
- 4 Programming LED (recessed)
- 5 Programming button (recessed) for teaching instrument
- 6 Push button for raising the ambient temperature (target value)
- 7 Air circulation holes (BOTTOM)

2.3.2. Rear view of casing with sensor board

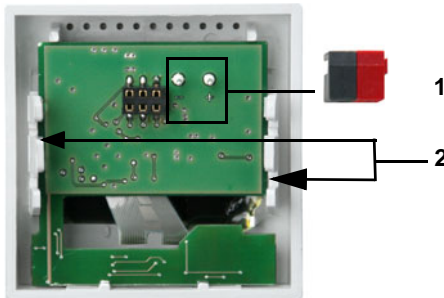


Fig. 2

- 1 Slot for KNX terminal BUS +/-
- 2 Notches

2.4. Assembly of the sensor

First of all fit the socket with connection. Seal inlet pipes to avoid infiltration. Then screw the base plate onto the socket and position the frame of the switching programme. Connect the bus line +/- (black-red plug) to the terminals provided on the sensor board of the sensor. Pin the sensor with the notches on to the metal frame, so that sensor and frame are fixed.

2.5. Notes on mounting and commissioning

Sensor must not be exposed to water (rain) or dust. This could result in the electronic being damaged. A relative air humidity of 95% must not be exceeded. Avoid bedewing.

After the bus voltage has been applied, the device will enter an initialisation phase lasting 5 seconds. During this phase no information can be received via the bus.